



MacLean Power
Systems
7801 Park Place Rd., York, SC 29745
USA (803) 628-2100

MPS Catalog Number

H7 40 20 016 MX SS 008

Revision: PD-4

Date 1/23/2023

End Fittings

Tower End Fitting:

3/4"-10 Round Base (Galv. Duct. Iron)

Line End Fitting:

Horizontal Trunnion (Aluminum)

Material

Number of Sheds:

8

Rod Diameter:

1-3/4"

Weight Estimate:

17.6 lbs

8.0 kg

Dimensional Values

Section Length (L):

25.0 in 634 mm

Rubber Length (X):

15.9 in 404 mm

Shed Height (P):

2.4 in 62 mm

Shed Diameter (B):

6.9 in 175 mm

Shed Spacing (S):

2.0 in 52 mm

Dry Arc Distance:

18.4 in 467 mm

Leakage Distance:

51.5 in 1308 mm

Electricals Values

60 Hz dry Flashover:

211 kV

Min. Withstand

177 kV

60 Hz Wet Flashover:

169 kV

Min. Withstand

128 kV

Positive CIFO:

320 kV

Min. Withstand

283 kV

Negative CIFO:

372 kV

Min. Withstand

316 kV

Mechanical Values

Max. Design Cant. Load (MDCL):


1,350 lbs 6. kN

Specified Cant. Load (SCL):

2,800 lbs 12.5 kN


Specified Tensile Load (STL):

5,000 lbs 22.2 kN

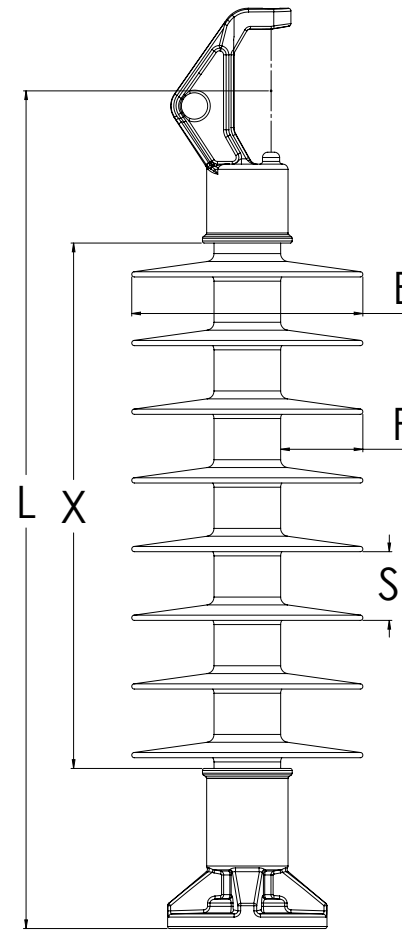

ϕ 0.66 ∇ 1.17
3/4-10 UNC - 2B ∇ 1.00

ϕ 4.75



Dimension: inches [millimeters]

Insulator assembly complies with ANSI C.29.18 and CSA C411.6 Standards

NOTE: Drawing not actual depiction of insulator appearance

Part Marking:

MPS WO#
H7 40 20 016 MX SS 008
MDCL 1,350 lbs/6.0 kN

This drawing contains confidential information that is the property of MacLean Power, L.L.C. ("MacLean"). Use of MacLean's confidential information without MacLean's express written consent is strictly prohibited and may expose you to legal liability. If you believe that you received this material in error, please destroy it or return it to "MacLean Power, L.L.C., 7801 Park Place Rd., York, South Carolina 29745, USA."